



Testing. Advising. Assuring.

EWFA CERTIFICATE OF ASSESSMENT	CERTIFICATE No : SFC 22953a-07	Page 1 of 3
---------------------------------------	---------------------------------------	--------------------

Report Sponsor	Certificate Issue Date	Product Name
Sekisui Chemical Co., Ltd. 2-3-17, Toranomon, Minato-ku, Tokyo, 105-0198, Japan	04/06/2012	Sekisui Fi-Block™ ST30, ST40- Plasterboard Walls

Assessment Report Reference	Test Methods	Report Issue Date	Report Validity Date
EWFA 22953-07	AS1530.4-2005 and AS4072.1-2005	04/06/2012	31/05/2015

Introduction
The element of construction described below was assessed by this laboratory on behalf of the report sponsor in accordance with the stated test standard and achieved the results stated below. Refer to the referenced test report(s) or Regulatory Information Reports for more information.

Table 1 - Performance of Fi-Block™ protecting insulated pipe in Gypsum plasterboard wall					
Max. Pipe Ø (mm)	Min. Pipe Wall Thickness (mm)	Insulation Material (Table 3)	Insulation Tube (Item 2) Thickness (mm)	Fire Stopping Strip (Item 3, 11)	FRL
Refer Table 2		(b), (c), (d) or (e)	30	ST30	-/120/30
		(a)	30	ST30	-/120/-
		(a), (b), (c), (d) or (e)	40	ST40	-/90/-
Refer Table 2		(b), (c), (d) or (e) + (f)	30	ST30	-/120/120
		(a) + (f)	30	ST30	-/120/120
		(a), (b), (c), (d) or (e) + (f)	40	ST40	-/90/90

Conditions/Validity
<ul style="list-style-type: none"> THIS CERTIFICATE IS PROVIDED FOR GENERAL INFORMATION ONLY AND DOES NOT COMPLY WITH THE REGULATORY REQUIREMENTS FOR EVIDENCE OF COMPLIANCE. Reference should be made to the relevant test report or regulatory information report to determine the applicability of the test result to a proposed installation. Full details of the constructions and justification for the conclusions given, along with the validity statements, are given in the assessment reports. The assessment report or short form assessment report does not provide an endorsement by Exova Warringtonfire Aus Pty Ltd of the performance of the actual products supplied. This certificate of assessment has been compiled by Exova Warringtonfire Aus Pty Ltd for Sekisui Chemical Co Ltd. It is intended to provide a brief outline of the above referenced assessment reports and not to replace them. The conclusions in this certificate of assessment relate to the configurations as detailed, and should not be applied to any other configuration. The conclusions expressed in this document assess fire hazard, but it should be recognised that a single test method will not provide a full assessment of fire hazard under all conditions. Full copies of the assessment and relevant test reports may be obtained from the sponsor.



TESTING AUTHORITY	Exova Warringtonfire Aus Pty Ltd
Address	Suite 2002a, Level 20, 44 Market Street, Sydney NSW 2000, Australia
Phone / Fax	+61 (0)2 8270 7600 / +61 (0)2 9299 6076
ABN	81 050 241 524
Email / Home Page	www.exova.com
Authorisation	<div>Prepared By:</div> <div></div> <div>S. Hu</div> <div>Reviewed By:</div> <div></div> <div>K. G. Nicholls</div>

Table 1 - Performance of Fi-Block™ protecting insulated pipe in Gypsum plasterboard wall (continued)

Max. Pipe Ø (mm)	Min. Pipe Wall Thickness (mm)	Insulation Material (Table 3)	Insulation Tube (Item 2) Thickness (mm)	Fire Stopping Strip (Item 3, 11)	FRL
13	0.71	(a) or (b)	30	ST30	-/180/90
		(c), (d) or (e)	30	ST30	-/120/90
		(a), (b), (c), (d) or (e)	50	ST40	-/120/90
13	0.71	(a) or (b) + (f)	30	ST30	-/180/120
		(c), (d) or (e) + (f)	30	ST30	-/120/120
		(a), (b), (c), (d) or (e) + (f)	50	ST40	-/120/120

Table 2 – Pipe Details

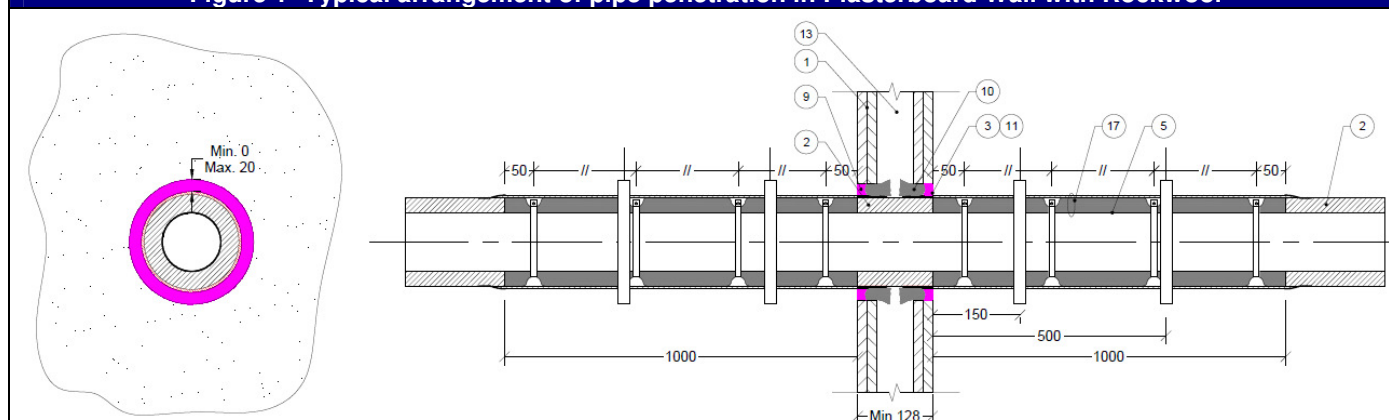
Nominal Size (mm)	Actual Ø (mm)	Actual Wall Thickness (mm)
100	101.60	1.22
90	88.90	1.22
80	76.20	1.22
65	63.50	0.91
50	50.80	0.91
40	38.10	0.91
32	31.75	0.91

Table 3 - Insulation Material

a	Polyethylene laminated with aluminium foil ('THERMOBREAK' by Sekisui Pilon)
b	Polyethylene (by Sekisui Pilon)
c	Acrylonitril Butadiene Rubber ('ARMAFLEX' by Armacel)
d	Ethylene Propylene Diene Rubber ('AEROFLEX' by Eastern Polymer Industry)
e	Acrylonitril Butadiene Rubber / PVC ('K-FLEX' by L'Isorante K-Flex)
f	38mm thick Fibretex 450 Rockwool

Table 4 - Schedule of Components

Item	Description
1	Plasterboard Wall Linings
2	Insulation Tube Thickness Table 1, Material Table 3
3	Fire Stopping Strip, ST40. The Fi-Block™ strips may be scored on one side by pressing grooves into the material without removing material from the strip.
5	Metal pipe Refer Table 1 and Table 2
9	Sealant (refer to EWFA 22953-02)
10	Sealant Backing Material
11	Fire Stopping Strip, ST30. The Fi-Block™ strips may be scored on one side by pressing grooves into the material without removing material from the strip.
13	Steel framing
17	Rockwool Insulation wrapped with 5mm thick Thermobreak

Figure 1- Typical arrangement of pipe penetration in Plasterboard Wall with Rockwool

Note: Multiple pipes are permitted, provided the separation from aperture edge to aperture edge is at least 40mm.

Min. 0
Max. 20

Fire Side

13
1
9
10
3
11
2
5

150mm
500mm
Min 128

Support

Figure 1 consists of two diagrams. Diagram (a) is a top view of a circular specimen with a central hole. The central hole has a diameter of 128 mm, with a minimum dimension of 128 mm indicated. The outer diameter of the specimen is 20 mm, with a maximum dimension of 20 mm indicated. Diagram (b) is a side view of the specimen, showing the fire side, support, and dimensions. The specimen has a length of 500 mm. The central hole has a diameter of 128 mm. The support has a diameter of 128 mm. The fire side is indicated by a wavy line. The support is indicated by a vertical line. The dimensions 150 mm and 500 mm are shown for the specimen length and support diameter respectively.

Exova
Warringtonfire